

WL3

COSHH essentials for welding, hot work and allied processes



This information will help employers (including the self-employed) comply with the Control of Substances Hazardous to Health

Regulations 2002 (COSHH), as amended, to control exposure and protect workers' health.

It is also useful for trade union safety representatives.

Welding fume can cause lung disease, with an increased risk of asthma and cancer.

Cutting fume is associated with an increased risk of lung disease and asthma.

This sheet describes good practice using engineering control - fixed extraction.

It covers the points you need to follow to reduce exposure to an adequate level.

It is important to follow all the points, or use equally effective measures.

Main points

- Dust and fume can cause serious lung diseases.
- Keep exposure as low as possible using all the controls in this sheet.
- Design, install, commission and maintain engineering controls. See sheet G406.
- Health monitoring is usually needed. See sheet G401.
- See manufacturers' safety data sheets - select safer consumables.

Fixed extraction: Welding booth or downdraught bench

Control approach 2 Engineering control

Access and premises


- ✓ Only allow access to authorised staff.
- ✓ Locate the work away from doors, windows and walkways. Stop draughts interfering with the extraction.

Equipment

- ✓ Provide a good standard of general ventilation; 5-10 air changes per hour, with a through draught.
- ✓ Provide an extracted booth or welding bench. See illustrations.
- ✓ You need an inward air speed between 1 and 1.5 metres per second into a booth.
- ✓ You need an air speed of at least 2 metres per second into an extracted welding bench.
- ✓ Fit a manometer, pressure gauge or tell-tale to show that the extraction is working.
- ✓ Discharge cleaned, extracted air to a safe place outside the building, away from doors and windows.
- ✓ Have a supply of clean air coming into the workroom to replace extracted air.
- ✓ Keep fume emissions as close as possible to the extraction point.
Can you provide a turntable to help this?



Downdraught bench with turntable

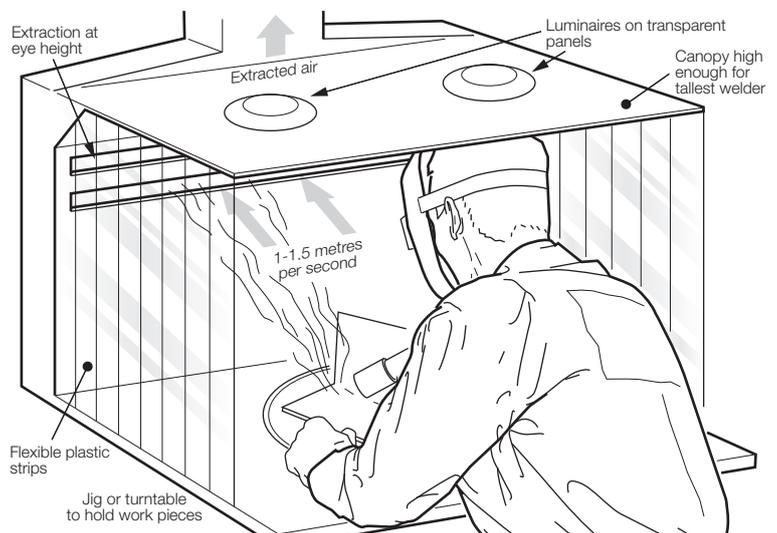

Extracted booth with turntable

Procedures

- ✓ Remove grease and all surface coatings first, unless they are meant to be welded or cut through.
- ✓ Arrange work so that the worker's head is out of the fume.
- ✓ Confirm that extraction is turned on and working.
- ✓ Workers should stand to the side of a booth, not in the air flow.
- ✓ Check for gas leaks.

Maintenance, examination and testing

- ✓ Follow the instructions in the manual - keep equipment in effective and efficient working order.
- ✓ If any equipment is faulty, repair it straight away.
- ✓ Daily, look for signs of damage to ducting, fans and air filters. Noisy or vibrating fans can indicate a problem.
- ✓ At least once a week, check that the extraction system and gauges work properly.
- ✓ You need to know the manufacturer's specifications to check the extraction's performance.
- ✓ If this information isn't available, hire a competent ventilation engineer to determine the performance needed for effective control.
- ✓ The engineer's report must show the target extraction rates.
- ✓ Keep this information in your testing log-book.
- ✓ Get a competent ventilation engineer to examine the extraction thoroughly and test its performance at least once every 14 months, or six months for non-ferrous metals. See the HSE publication HSG54 - see 'Further information'.
- ✓ Keep records of all examinations and tests for at least five years.
- ✓ Review records - failure patterns show where preventive maintenance is needed.
- ✓ If hot work involves cadmium, seek advice on biological monitoring - see 'Useful links'.

Personal protective equipment (PPE)

- ✓ Provide storage for clean and contaminated PPE.

Respiratory protective equipment (RPE)

- ✓ RPE should not be needed.


Other protective equipment

- ✓ Provide and ensure that workers use a welding helmet, flame-resistant overalls and protective gloves.
- ✓ Use a properly equipped contract laundry or a suitable equivalent to wash work clothing.
- ✓ Skin creams help in washing contamination from the skin. After-work creams help to replace skin oils.

Caution: Never allow use of compressed air for removing dust from clothing.

Health monitoring

- ✓ You should consider health monitoring. See sheet G401.
- ✓ Consult an occupational health professional - see 'Useful links'.

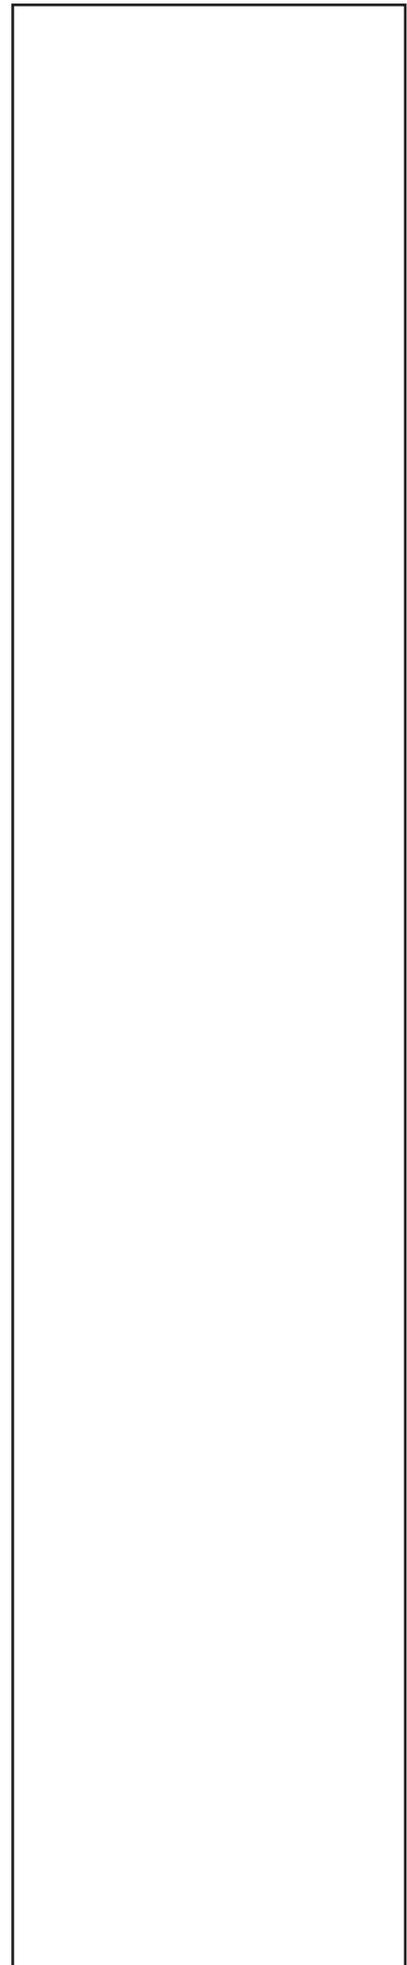

Cleaning and housekeeping

- ✓ Keep the work area clean and free of combustible materials.
- ✓ Clean the general workroom once a week.
- ✓ Dispose of hazardous wastes safely.

Training and supervision

- ✓ Tell workers that fume from welding and cutting can cause serious lung diseases.
- ✓ Working in the right way and using the controls correctly is important for exposure control. Train and supervise workers. See sheet WLO.

Further information

- *Maintenance, examination and testing of local exhaust ventilation* HSG54 (Second edition) HSE Books 1998 ISBN 0 7176 1485 9
- *The safe use of compressed gases in welding, flame cutting and allied processes* HSG139 HSE Books 1997 ISBN 0 7176 0680 5
- *Health and safety in arc welding* HSG204 HSE Books 2000 ISBN 0 7176 1813 7
- *Cadmium in silver soldering or brazing* Engineering Information Sheet EIS31 HSE 1999 Web only version available at www.hse.gov.uk/pubns/eis31.pdf
- *Thoriated tungsten electrodes* Information document OC 564/6(rev) HSE 1995 Web only version available at www.hse.gov.uk/foi/internalops/fod/oc/500-599/564_6r.pdf
- For environmental guidelines see sheet WLO

Useful links

- Your trade association may advise on health and safety consultants and training providers.
- For information about health and safety, or to report inconsistencies or inaccuracies in this guidance, visit www.hse.gov.uk/. You can view HSE guidance online and order priced publications from the website. HSE priced publications are also available from bookshops.
- Contact the British Occupational Hygiene Society (BOHS) on 01332 298101 or at www.bohs.org for lists of qualified hygienists who can help you.
- Look in the Yellow Pages under 'Health and safety consultants' and 'Health authorities and services' for 'occupational health'.
- Also see www.nhsplus.nhs.uk.
- Biological monitoring - contact the Health and Safety Laboratory (HSL) e-mail hslinfo@hsl.gov.uk, or other service laboratories.

This document is available at: www.hse.gov.uk/pubns/guidance/ and www.hse.gov.uk/coshh/essentials/

This document contains notes on good practice which are not compulsory but which you may find helpful in considering what you need to do.

© Crown copyright If you wish to reuse this information visit www.hse.gov.uk/copyright.htm for details. First published 04/06.

Employee checklist

- Do you know how to use the controls properly?
- Is the extraction working?
- Use, maintain and store your protective equipment in accordance with instructions.
- Look for signs of leaks, wear and damage.
- If you find any problems, tell your supervisor. Don't just carry on working.
- Co-operate with health monitoring.
- Wash your hands before eating, drinking, or using the lavatory.
- Never clean your hands with solvents or concentrated cleaning products.
- Use skin creams provided as instructed.